


alarm signal  
from AOV panel  
(optional)  
Use as interface zone  
(non latch, non relay activation)

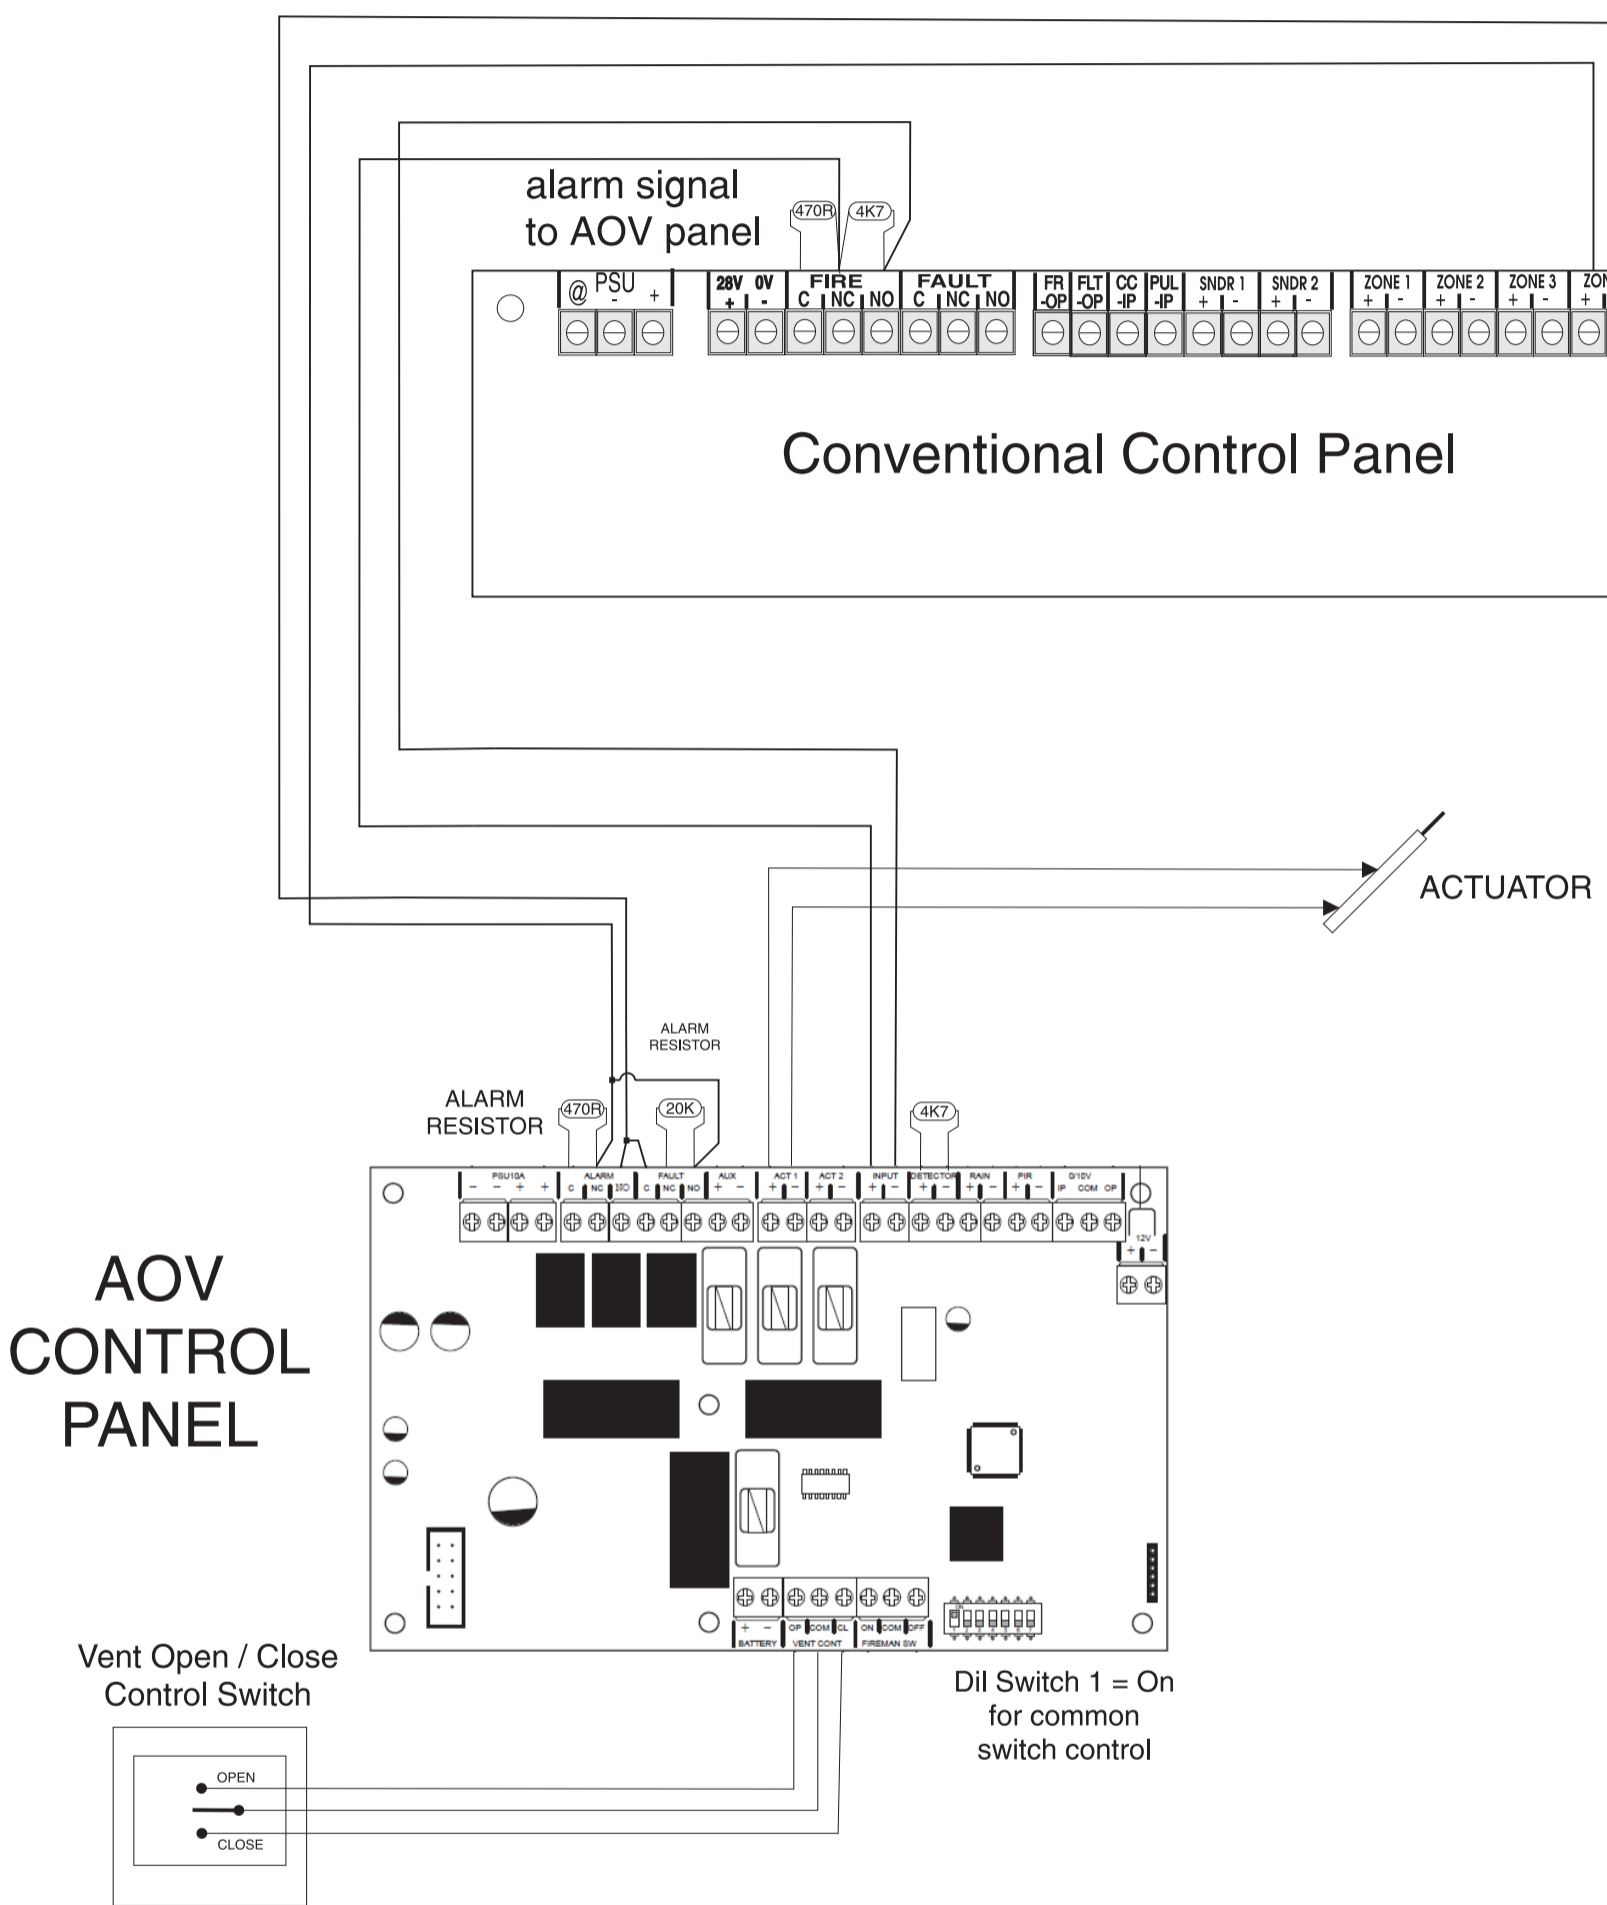

Note:- AOV input non latching  
will automatically reset when  
conventional panel is reset.

Approved by	Date	Issue	Title/Description
	24/02/17	1	AOV panel controlled via conventional fire panel
<b>DRAWING No</b>		<b>CCD-2997-203</b>	
<b>Drawn by:</b>		<b>M.DURBRIDGE</b>	